



5700 Series GUIDED WAVE RADAR Quick Start Guide



INSTALLATION, OPERATION & MAINTENANCE MANUAL

SAFETY INFORMATION

Before installing the 5700 Series model, please read these instructions and familiarize yourself with the requirements and functions. If any questions or problems arise during the installation, please contact Niagara® Applications at 1-800-778-9242.

The 5700 Series model must only be installed and operated as described in this operating instruction. Please note that other action can cause damage for which Niagara® does not take responsibility. If the model is not installed correctly or used in approved applications, dangers may arise such as product overflow.

Ensure that all personnel installing, wiring, and calibrating this device are suitably qualified.

Observe all local and national electrical codes for the wiring of this device.

The 5700 Series level gauge is designed solely for measuring the distance, level and volume of liquids, solids and particulate materials.

Special codes and regulations apply to its use in hazardous areas.

Responsibility as to suitability and intended use of these level gauges rests solely with the user.

Improper installation and operation of our level gauges may lead to loss of warranty.

TABLE OF CONTENTS

1.0 Range of Use	1
2.0 Description	1
3.0 Measured Variable (distance, level, volume)	
3.1 Measuring Range	1
4.0 Mounting	
4.1 Excessive Bending of the Cable	2
4.2 Mounting on a Nozzle	2
4.3 Interference between two TDR's	2
5.0 Electrical Connection	3
6.0 Technical Specifications	4
7.0 Programmed Information	5

1.0 RANGE OF USE


The 5700 Series level gauging system is a 2 wire transmitter, designed to measure the distance, level and volume of liquids, slurries, solids and particulate materials. It can be operated on storage and process tanks.

2.0 Description

The measuring system consists of the sensor and the signal converter. The compact signal converter contains the TDR measuring circuit and the entire signal processing system, including the provision of a standardized output signal (4 - 20 mA or digital interface).

Converter Connection

1.5 MNPT; electrical 1" G (grommet open lead) Connection with Pressure tight Signal feed through

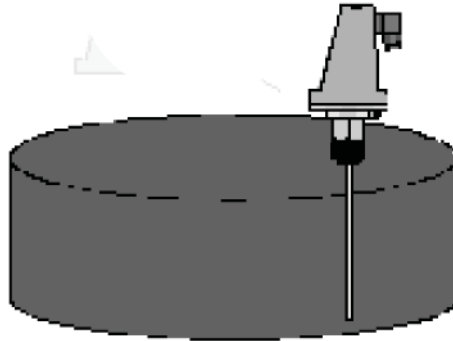

3.0 Measured variable (distance, level, volume)

The primary measured variable is the distance between the tank mounting flange and a reflecting surface (surface of the product measured). The output represents the difference between the primary measured variable and the length of the sensor.


3.1 Measuring range (to 78 ft)

The measuring range will depend on the sensor length, the reflection properties of the tanks contents, the installation position, and the presence of any interfering reflection

4.0 Mounting, please refer to the following guidelines:


ENSURE THE SENSOR LENGTH DOES NOT EXCEED THE INTERNAL DEPTH OF THE SILO, TANK OR VESSEL.

Single cable
12" Min

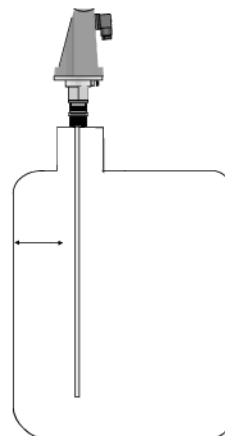


4.1 Excessive bending of the cable

BE CAREFUL NOT TO BEND OR KINK CABLES TOO MUCH

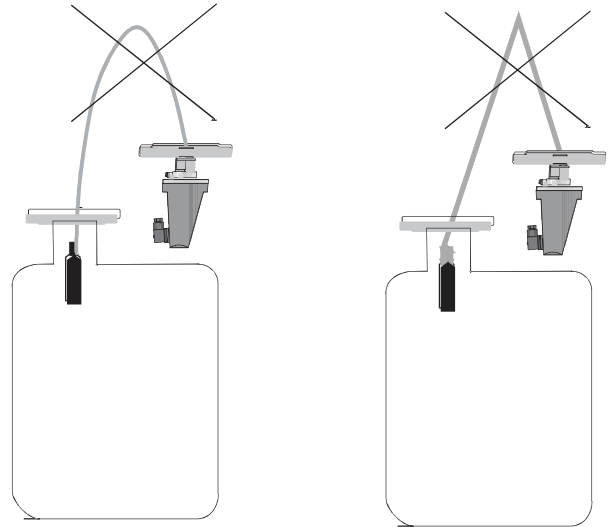

4.2 Mounting on a nozzle

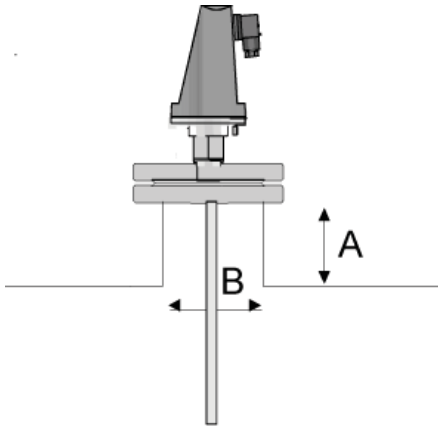


Avoid nozzle size higher than 5.9", especially when $B < 3.1$ ".

Try to ensure A does not exceed B.

4.3 Interference between two 5700 Series

There must be at least 6.5ft between devices if installed in the same vessel.

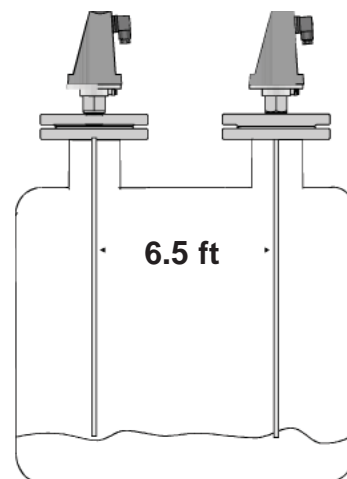

5.0 Electrical connection

The electrical connection for the power supply is made in the terminal compartment of the signal converter - 18-35VDC.

In case of installation in hazardous areas, only certified intrinsically safe equipment may be connected to the 5700 Series.

1. Connector:


Terminals:	3 poles + ground. Wire cross-section max 0.059m^2 (1.5 mm^2) \approx (AWG 16).
Cable entries:	M25x1.5 (PG11). Standard cable gland: cable clamping area = 0.315 - 0.39 in (8-10 mm). IP65
Signal cable shielding:	No shielding needed.

Power supply:

1. Remove the screw **P** and lift off the connector from the signal converter.
2. Put a screwdriver in **F** and separate **N** from **R**.
3. Connect the current loop to terminal 1 and 2 (there's no polarity to respect). Use ferrules to protect cable ends. The terminal 3 and **E** remain non-connected.
4. Re-assemble **N** and **R**.
5. Put the seal in place, connect **R** to the signal converter tighten and screw **P**.

The terminal **E** is not connected with the signal connector housing or with the flange system of the instrument.

For standard and Ex applications only the intrinsically safe 2-wire loop must be connected to the terminals 1 and 2. The terminal **E** as well as terminal 3 remains non-connected.

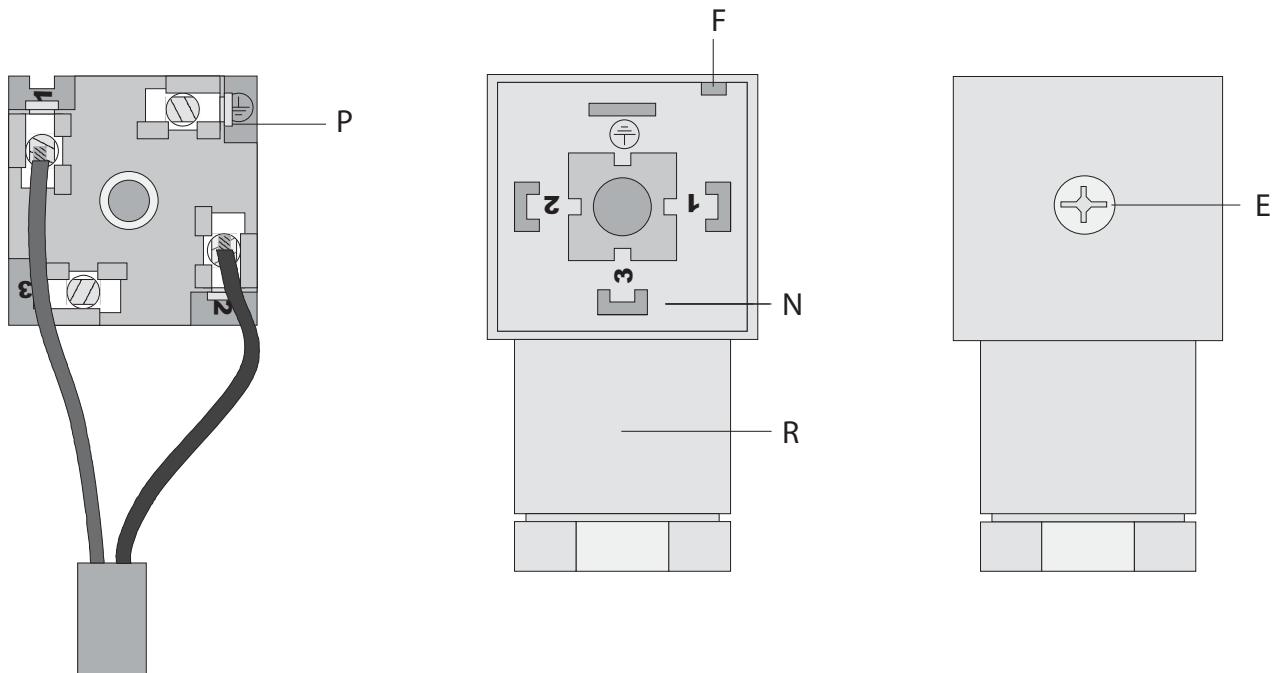

6.0 Technical Specifications

Function:	Level, distance and volume measurement of liquids and solids.
Measuring Range:	Flexible probe: to 78 ft Deadband: Top: 15.8 in Dielectric < 10 11.8 in Dielectric > 10 Deadband: Bottom: 10.25 in Counter Weight Diameter.: 1.575 in; length 10.25 in (Weight is tapped with 1/2" - 13 to allow tethering or anchoring)
Accuracy:	+/- 0.6 in
Repeatability:	0.04 in
Dielectric Constant:	> 2.3
Probe Materials:	Flexible cable 316SS
Operating Pressure:	232 psi
Flange Temperature:	-22° to 194°F
Electronics Temperature:	-22° to 131°F
Connection:	1.5" MNPT
Protection Category:	IP66; Nema 4X
Power Supply:	24VDC (18 to 35VDC)
Output:	4/20mA current loop into max. of 750 Ohms
Communication:	HART protocol
Approvals:	CE
Weight:	Without probe 4.4lbs (2Kgs)
Materials of Construction:	Housing: Aluminium with white epoxy coating Cable and Weight: 316SS Gaskets: Buna N

Electrical Connection

Terminals:	Wire Cross section max AWG 16 (1.5mm)
Cable Entries:	1 x M16 x 1.5 (with standard cable gland: cable clamping area =0.137 - 0.315in(3.5-8mm)).

Electrical Signal Output

Electrical Connection:	Two wire
Power Supply:	18 to 35 VDC
Current Output:	4/20mA

Environment

Ambient Temperature:	-22° to 131°F
Protection Category to EN 60529 / IEC 529:	IP66, Nema 4X

7.0 Programmed Information

CHECK LIST PARAMETERS 5700 Series to: _____ Date: _____

Device No. _____ Comm. No. _____

Location _____

Contact person _____ Telephone _____

Remarks: _____

Menu item _____ Changed on _____

Fct. Configuration parameters (customer)

1.1.1 Tank height _____ : _____
 1.1.2 Dead zone _____ : _____
 1.1.3 Time constant _____ : _____
 1.1.6 Probe length _____ : _____
 1.2.4 Length unit _____ : _____
 1.2.6.1 Unit name _____ : _____
 1.2.6.2 Unit factor _____ : _____
 1.2.5 Volume unit _____ : _____
 1.3.1 Current output, function _____ : _____
 1.3.2 Current output, range/error _____ : _____
 1.3.3 Min. scale for current _____ : _____
 1.3.4 Max. scale for current _____ : _____
 1.3.5 Error delay _____ : _____
 1.4.4 Tag name _____ : _____
 1.5.1 Detection delay _____ : _____
 1.6.2 Address _____ : _____
 Threshold _____ : _____

Fct. Configuration parameters (factory)

1.1.1 Probe type _____ : _____
 1.1.2 Offset of measure _____ : _____
 1.1.3 Application type _____ : _____
 1.1.4 Dielectric _____ : _____
 2.1 Set value of electronic offset _____ : _____
 2.4 Electronic Calspeed _____ : _____
 2.5 Mechanic Calspeed _____ : _____
 2.6 Reference frequency _____ : _____

Fct. Strap table configuration (20 points)

Point	0 Level _____	Volume _____
Point	1 Level _____	Volume _____
Point	2 Level _____	Volume _____
Point	3 Level _____	Volume _____
Point	4 Level _____	Volume _____
Point	5 Level _____	Volume _____
Point	6 Level _____	Volume _____
Point	7 Level _____	Volume _____
Point	8 Level _____	Volume _____
Point	9 Level _____	Volume _____
Point	10 Level _____	Volume _____
Point	11 Level _____	Volume _____
Point	12 Level _____	Volume _____
Point	13 Level _____	Volume _____
Point	14 Level _____	Volume _____
Point	15 Level _____	Volume _____
Point	16 Level _____	Volume _____
Point	17 Level _____	Volume _____
Point	18 Level _____	Volume _____
Point	19 Level _____	Volume _____

Notes



150 VENTURE BOULEVARD
SPARTANBURG, SC 29306
PHONE: 864.574.8060, FAX: 864.574.8063
CUSTOMER CARE: 800.778.9242
WWW.Niagarameters.COM
SALES@Niagarameters.COM

venture
MEASUREMENT

2008 ALL RIGHTS RESERVED
ALL DATA SUBJECT TO CHANGE

60500S096 Rev. A